

Solid-state reversing contactor - ELR W3-230AC/500AC- 9I - 2297060

Please be informed that the data shown in this PDF Document is generated from our Online Catalog. Please find the complete data in the user's documentation. Our General Terms of Use for Downloads are valid (<http://phoenixcontact.com/download>)



"4 in 1" three-phase semiconductor reversing contactor with 230 V AC input, 9 A output current, emergency stop function, and adjustable overload switching.

Product Features

- 22.5 mm wide
- Safety level according to IEC 61508-1: SIL 3, ISO 13849: PL e
- Long service life
- Reduction in wiring
- Space saving
- 3-phase loop bridges
- Bimetal function can be set up to 9 A



Key Commercial Data

Packing unit	1 pc
Weight per Piece (excluding packing)	284.1 g
Custom tariff number	85371099
Country of origin	Germany

Technical data

Input data

Input name	Device supply
Mains frequency	40 Hz
	100 Hz
Rated control circuit supply voltage U_S	230 V AC
Voltage range with reference to U_S	0.4 ... 1.1
Control supply voltage range	92 V AC ... 253 V AC
Rated control supply current I_S	4 mA

Solid-state reversing contactor - ELR W3-230AC/500AC- 9I - 2297060

Technical data

Input data

Rated actuating voltage U_C	230 V AC
Voltage range with reference to U_C	0.4 ... 1.1
Rated actuating current I_C	7 mA
Protective circuit	Surge protection
Typical response time	< 35 ms
Typical turn-off time	< 80 ms
Operating voltage display	Green LED
Status display	Yellow LED
Indication	Red LED
Input name	Control input right/left
Switching threshold	44 V AC ("0" signal)
	85 V AC ("1" signal)

Output data load output

Nominal output voltage	500 V AC
Nominal output voltage range	42 V AC ... 550 V AC
Load current range	1.5 A ... 9 A (see to derating)
Rated operating current at AC-51	9 A
Rated operating current at AC-53a	6.5 A
Leakage current	0 mA
Residual voltage	< 0.5 V
Surge current	100 A (t = 10 ms)
Protective circuit	Surge protection

Output data reply output

Note	Confirmation 01: Floating PDT contact
------	---------------------------------------

Measuring technology and signaling contact

Measuring via	Current transformer for line current on L1 and L3
Current range	1 A ... 45 A

Connection data, control circuit

Connection name	Control circuits
Connection method	Screw connection
Stripping length	8 mm
Screw thread	M3
Conductor cross section solid	0.2 mm ² ... 2.5 mm ²
Conductor cross section flexible	0.2 mm ² ... 2.5 mm ²
Conductor cross section AWG	24 ... 14

Solid-state reversing contactor - ELR W3-230AC/500AC- 9I - 2297060

Technical data

Connection data load circuit

Connection name	Load circuit
Connection method	Screw connection
Stripping length	8 mm
Screw thread	M3
Conductor cross section solid	0.2 mm ² ... 2.5 mm ²
Conductor cross section flexible	0.2 mm ² ... 2.5 mm ²
Conductor cross section AWG	24 ... 14

General

Test voltage input/output	4 kV _{rms}
Mounting position	Vertical (horizontal DIN rail)
Assembly instructions	Can be aligned with spacing = 20 mm
Operating mode	100% operating factor
Designation	Standards/regulations
Standards/regulations	DIN EN 50178
	EN 60947
Designation	Power station requirements
Standards/regulations	DWR 1300 / ZXX01/DD/7080.8d
Designation	Air clearances and creepage distances between the power circuits
Standards/regulations	DIN EN 50178
Insulation	safe isolation
Degree of pollution	2
Overvoltage category	III
Reversing frequency	≤ 2 Hz

Dimensions

Width	22.5 mm
Height	99 mm
Depth	114.5 mm

Ambient conditions

Ambient temperature (operation)	-25 °C ... 70 °C
Ambient temperature (storage/transport)	-40 °C ... 80 °C
Degree of protection	IP20

UL data

SCCR	100 kA (480 V AC (fuse: 30 A class CC/30 A class J (high fault)))
	5 kA (480 V AC (fuse: 20 A RK5 (standard fault)))

Standards and Regulations

Solid-state reversing contactor - ELR W3-230AC/500AC- 9I - 2297060

Technical data

Standards and Regulations

Designation	Standards/regulations
Standards/regulations	DIN EN 50178
	EN 60947
Designation	Power station requirements
Standards/regulations	DWR 1300 / ZXX01/DD/7080.8d
Designation	Air clearances and creepage distances between the power circuits
Standards/regulations	DIN EN 50178
Insulation	safe isolation
Degree of pollution	2
Overvoltage category	III

Classifications

eCl@ss

eCl@ss 4.0	27371102
eCl@ss 4.1	27371102
eCl@ss 5.0	27371601
eCl@ss 5.1	27371601
eCl@ss 6.0	27371601
eCl@ss 7.0	27371601
eCl@ss 8.0	27371014

ETIM

ETIM 2.0	EC000066
ETIM 3.0	EC000066
ETIM 4.0	EC000066
ETIM 5.0	EC002055

UNSPSC

UNSPSC 6.01	30211915
UNSPSC 7.0901	39121514
UNSPSC 11	39121514
UNSPSC 12.01	39121514
UNSPSC 13.2	39121514

Approvals

Approvals

Solid-state reversing contactor - ELR W3-230AC/500AC- 9I - 2297060

Approvals

Approvals


UL Listed / cUL Listed / GL / GL-SW / IEC EE CB Scheme / UL Listed / cUL Listed / EAC / EAC / GL / cULus Listed


Ex Approvals

ATEX / ATEX

Approvals submitted


Approval details


UL Listed 

cUL Listed 

GL

GL-SW

IECEE CB Scheme 

UL Listed 

cUL Listed 

EAC

Solid-state reversing contactor - ELR W3-230AC/500AC- 9I - 2297060

Approvals


EAC

GL


cULus Listed

Drawings

Block diagram

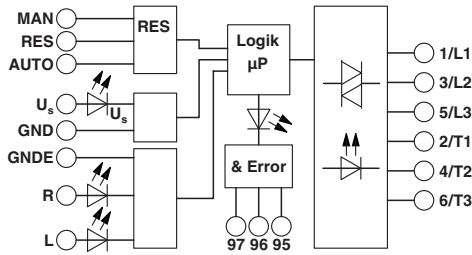


Circuit diagram

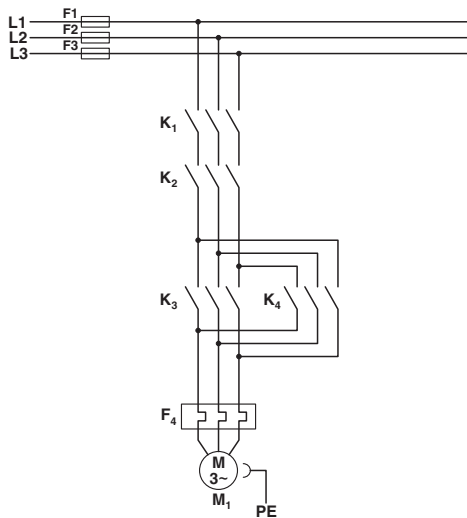


Conventional structure
Main current path for reversing contactor according to category 3

K1 + K2 = Emergency stop contactor

Diagram

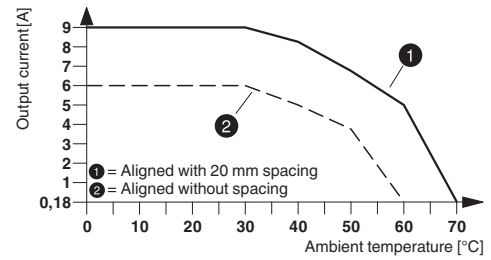

Circuit diagram

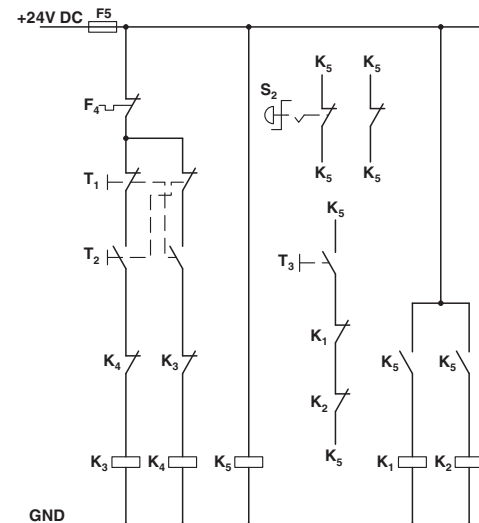

Conventional structure
Control current path reversing contactor according to category 3


K1 + K2 = Emergency stop contactor

Solid-state reversing contactor - ELR W3-230AC/500AC- 9I - 2297060

K3 = Left contactor
K4 = Right contactor
F4 = Motor protection relay

K3 = Left contactor
K4 = Right contactor
K5 = PSR SCP-24DC.../Safety relay
T1 = Right, T2 = Left, T3 = Reset
S2 = Emergency stop
F4 = Motor protection relay

Circuit diagram

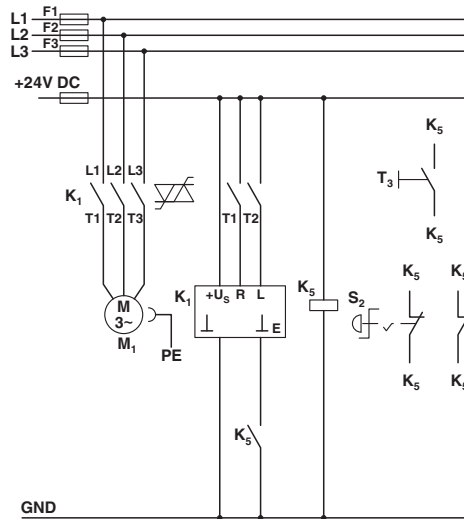

Structure with CONTACTRON

Main and control current path for '4 in 1' hybrid motor starter with reversing function according to category 3

K1 = '4 in 1' hybrid motor starter with reversing function

K5 = PSR SCP-24DC.../Safety relay

T1 = Right, T2 = Left, T3 = Reset

S2 = Emergency stop